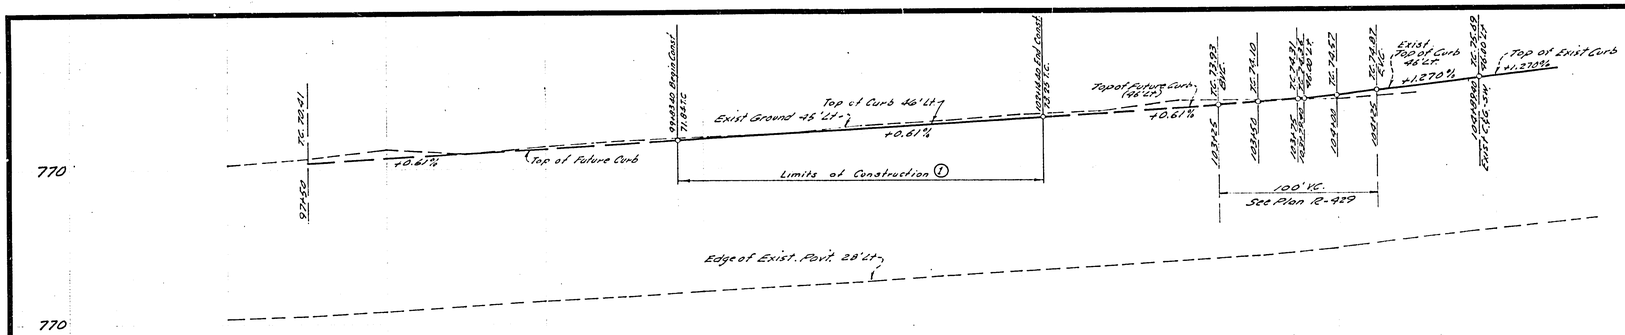

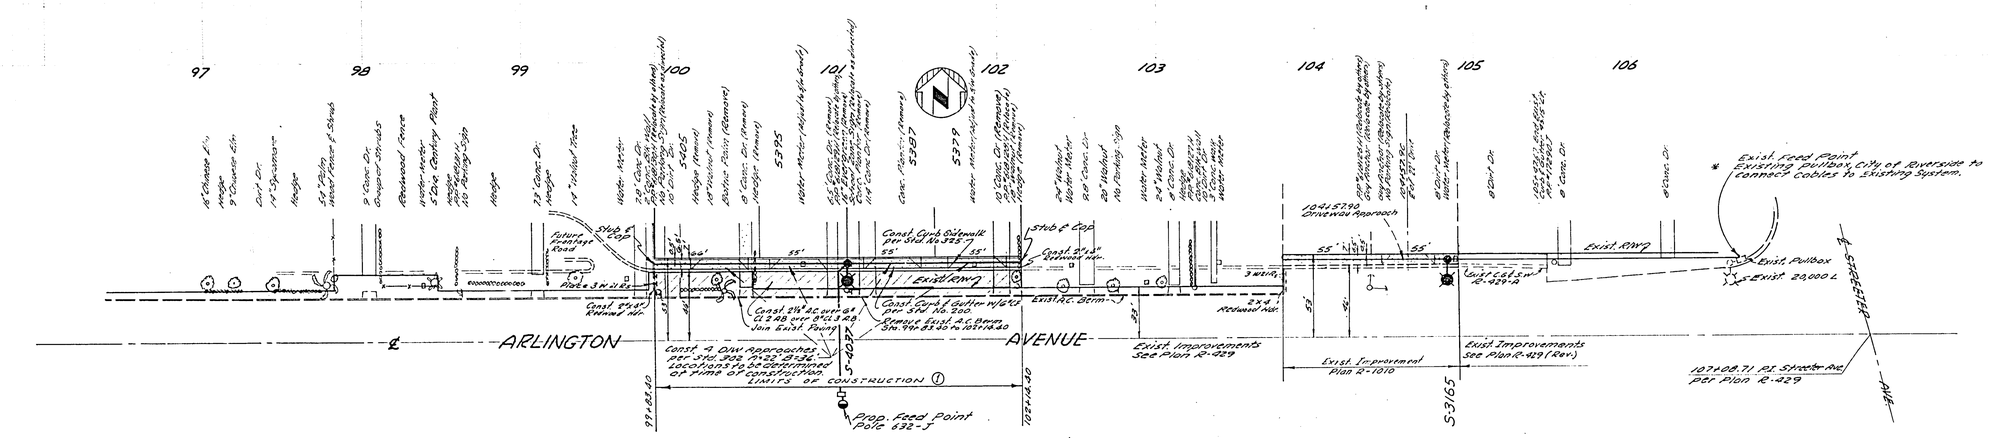

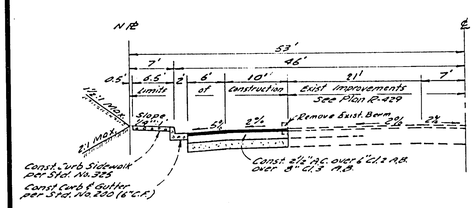

TYPICAL SECTION ①
ARLINGTON AVENUE
T.T. 7

STREET LIGHTING

LEGEND:

- Indicates City of Riverside Marbelite light standard No. 63710 with 2-20'0" L, 400 W, Type III "Lime Maximum" mercury vapor luminaire, Cat. No. L M53A2 or approved equal.
- Indicates No. 3½ pullbox "Brooks Products Inc." or approved equal.
- Indicates 1" rigid galv. steel conduit, except as noted.
- Indicates Feed Point.

770

NOTES:

1. All street light standards and pullboxes to be located in the field.
2. All street light standards shall be checked for clearance of driveways and placed 1' from end of curb return.
3. See City of Riverside Drwg. No. L1-13011 for light standard details and Drwg. No. L1-13003 for pullbox details.
4. All cable to be AWG No. 8 copper.
5. This is a 2 wire 240 volt multiple system.
6. All construction to comply with City of Riverside Street Light Specifications.
7. Inspections to be called for as outlined in specifications.
8. Feed point to be confirmed at time of construction.
9. $75.00 Connection fee paid 5-5-65.
10. The City of Riverside Traffic Engineering Division will pay $75.00 toward the cost of this project to the Developer upon completion of the work and receipt of a statement from the Developer.

GENERAL NOTES:

1. It shall be the responsibility of the contractor to clear the right of way in accordance with the provisions of law as it affects each utility including irrigation lines and appurtenances and at no cost to the City.
2. Construction shall be in accordance with the City of Riverside, Department of Public Works, Specifications No. 401 and Standard Drawings.
3. Prime coat, seal coat, and paint binder are required.
4. Grading will require a permit under Ordinance 3093 for a cut or fill exceeding 100 cubic yards, or a fill over one foot in depth.
5. Trim edge of existing pavement, where new paving joins existing pavement, to a clean straight line. Construct match-up paving as shown and overlay as directed in the field to produce a smooth crown section.
6. Contact Public Utilities Engineering @ 787-7421 for Street Light Requirements prior to sidewalk construction.
7. The finished subgrade shall have a compaction of not less than 90% for a depth of 6" as determined by test method No. "California 216" immediately prior to placement of the cover.

Bench Mark:
P.K. nail in lead S.W. curb return @
Arlington Ave. & De Camp Ct. - Elev. 772.55

CRAWLEY & HAWKINS
SURVEYORS AND ENGINEERS
Riverside, California
Approved George O. Crawley
Field Bk. 57-25
Date 1-20-65
70338

MARK	REVISIONS	APPR.	DATE
5	Revised feed point & luminaire		6-15-65
4	Revised Sheet 1 of 2 to show Arlington Ave. from 33' to 46' wide		7-30-65

DESIGNED BY ____ DRAWN BY B.C. CHECKED BY

CITY OF RIVERSIDE, CALIFORNIA
DEPARTMENT OF PUBLIC WORKS

APPROVED BY	BY	DATE
OFFICE ENGINEER		8-1-65
PARK DEPARTMENT		8-2-65
TRAFFIC DIVISION		8-2-65
ASSISTANT CITY ENG.		8-11-65

APPROVED BY
DIRECTOR OF PUBLIC WORKS
DATE

STREET PLAN & PROFILE
ARLINGTON AVENUE
NORTH SIDE
260' TO 370' WESTERLY OF STREETER AVE.
R-132-634

HORIZ. SCALE: 1" = 40' VERT. SCALE: 1" = 4'

PROJECT NO. SS 232
R-1010
L5-13104
SHEET 1 OF 1
FILE NO.

APPROVED BY
① Robert Campbell EXP. 8-16-65
GEN. SUPT. & CHIEF ENG. DATE

APPROVED BY
Don Campbell 5-6-65
GEN. SUPT. & CHIEF ENG. DATE