STREET LIGHT LEGEND & NOTES

1. Indicates City of Riverside marbelite light standard No. 4SDA with 7000L, 175W, Type II except as noted. Use Mallory "Lumcurv" vapor luminaire with color corrected lamp. Cat. No. LM 44A1, or approved equal.
2. Indicates No. 3½ pullbox "Brooks Products Inc." or approved equal.
3. Indicates 1" rigid galv. steel conduit, except as noted.
4. Indicate feed point
5. All street light standards and pullboxes to be located in the field.
6. All street light standards shall be checked for clearance of driveways and placed 1' from end of curb returns.
7. See City of Riverside Dwg. No. E1-13008 for light standard details and Dwg. No. E1-13003 for pullbox details.
8. All cable to be AWG No. 8 copper.
9. This is a 2 wire 240 volt multiple system.
10. All construction to comply with City of Riverside Street Light Specifications.
11. Feed point(s) to be confirmed at time of construction.
12. Feed point(s) to be determined.
13. *Fig. 52. Connection fee to be paid _____ Date paid.
14. *Fig. 22. Inspection fee to be paid _____ Date paid.
15. Inspections to be called for as outlined in the Specifications.

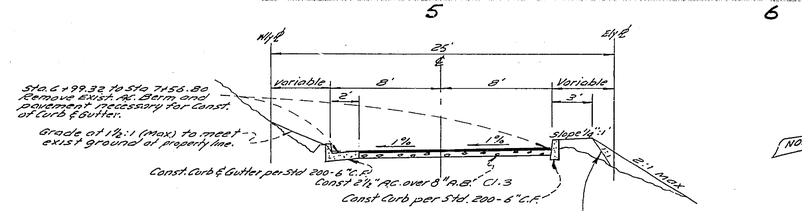

TYPICAL SECTION
VICTORIA HILL DRIVE
NO SCALE
T.I. 5

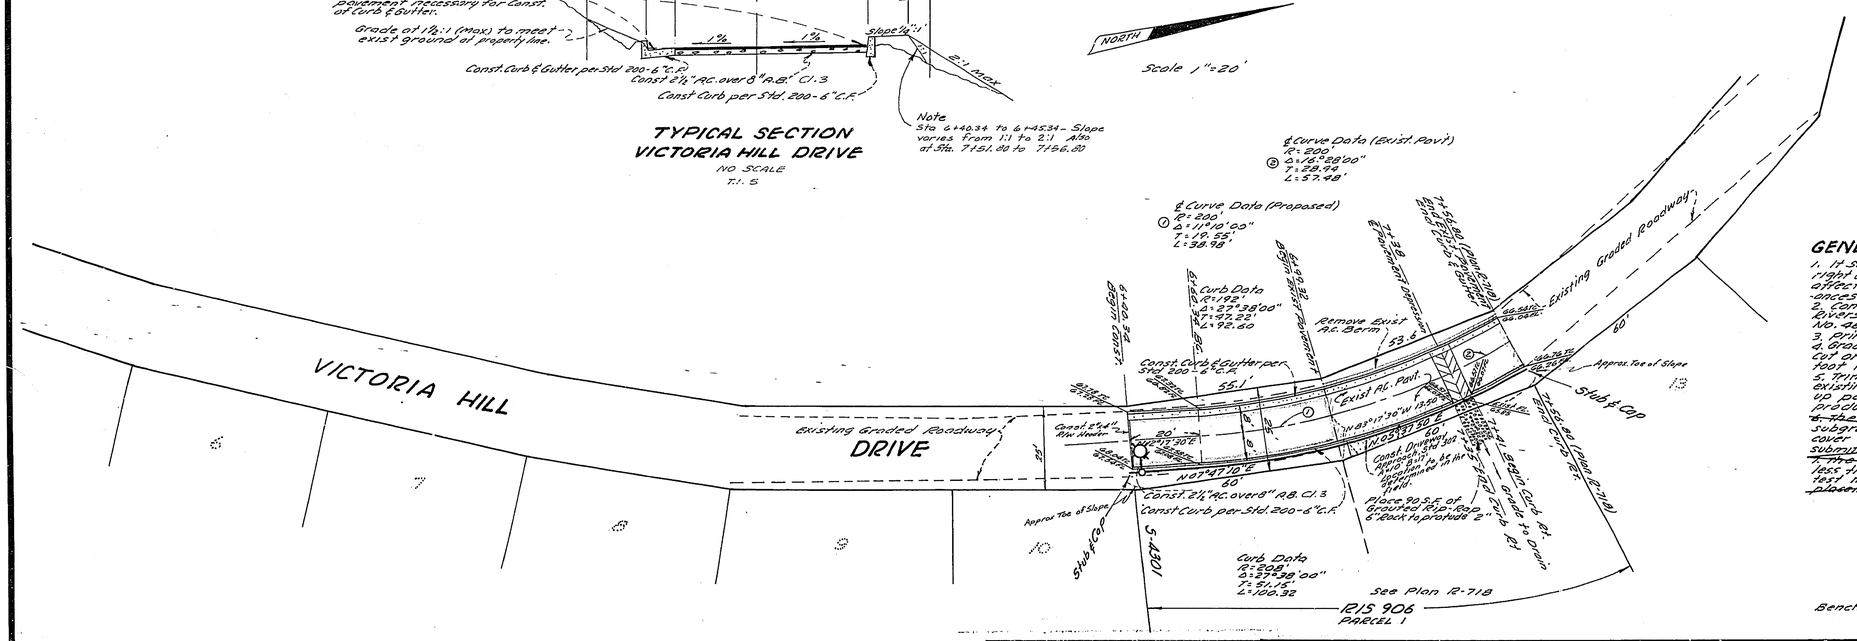

GENERAL NOTES:

1. It shall be the responsibility of the contractor to clear the right of way in accordance with the provisions of law as it affects each utility including irrigation lines and appurtenances over at no cost to the City.
2. Construction shall be in accordance with the City of Riverside Department of Public Works, Specifications No. 481 and Standard Drawings.
3. Prime Coat, Seal Coat and Paint binder are required.
4. Grading will require a permit under Ordinance 3093 for a cut or fill exceeding 100 cubic yards, or a fill over one foot in depth.
5. Trim edge of existing pavement, where new paving joins existing pavement, to a clean straight line. Construct match-up paving as shown and overlay as directed in the field to produce a smooth crown section.
6. ~~The developer shall arrange for a test of the soil at the subgrade level by a soils engineer. Depth and type of cover shall be determined by the soils engineer and submitted to the City of Riverside for approval.~~
7. ~~The finished subgrade shall have a compaction of not less than 90% for a depth of 6" or as determined by test method No. Calif. Hd 216 F. Immediately prior to placement of the cover.~~

Bench Mark: P.K. Nail & Tin in S.E. Cor. of Garage Slab 250'± N'ly of Myrtle Dr. on W'ly side of Victoria Hill Dr.

Approved for St. Lights
H. G. Tompkins DATE 6-2-66
Gen. Supt. & Chief Engr. (W.U.)

CRAWLEY, HAWKINS & HILBER
SURVEYORS AND ENGINEERS
Riverside, California
Approved George O. Crawley R.E. No. 9455
82-5
74-7
Field Bk. 27-19
Date 7-20-65

MARK	REVISIONS	APPR.	DATE

DESIGNED BY BC DRAWN BY BC CHECKED BY

CITY OF RIVERSIDE, CALIFORNIA
DEPARTMENT OF PUBLIC WORKS

APPROVED BY	BY	DATE
OFFICE ENGINEER		
PARK DEPARTMENT		
TRAFFIC DIVISION		
ASSISTANT CITY ENG.		

APPROVED BY William S. Hansbrough
DIRECTOR OF PUBLIC WORKS
DATE 4/6/67

STREET PLAN & PROFILE
R/S 906
VICTORIA HILL DRIVE
STA 6+40.34 TO STA 7+56.80

HORIZ. SCALE: 1" = 20' VERT. SCALE: 1" = 2'

PROJECT NO. 25-13191
R-1101
SHEET 1 OF 1
FILE NO. 4083

4083