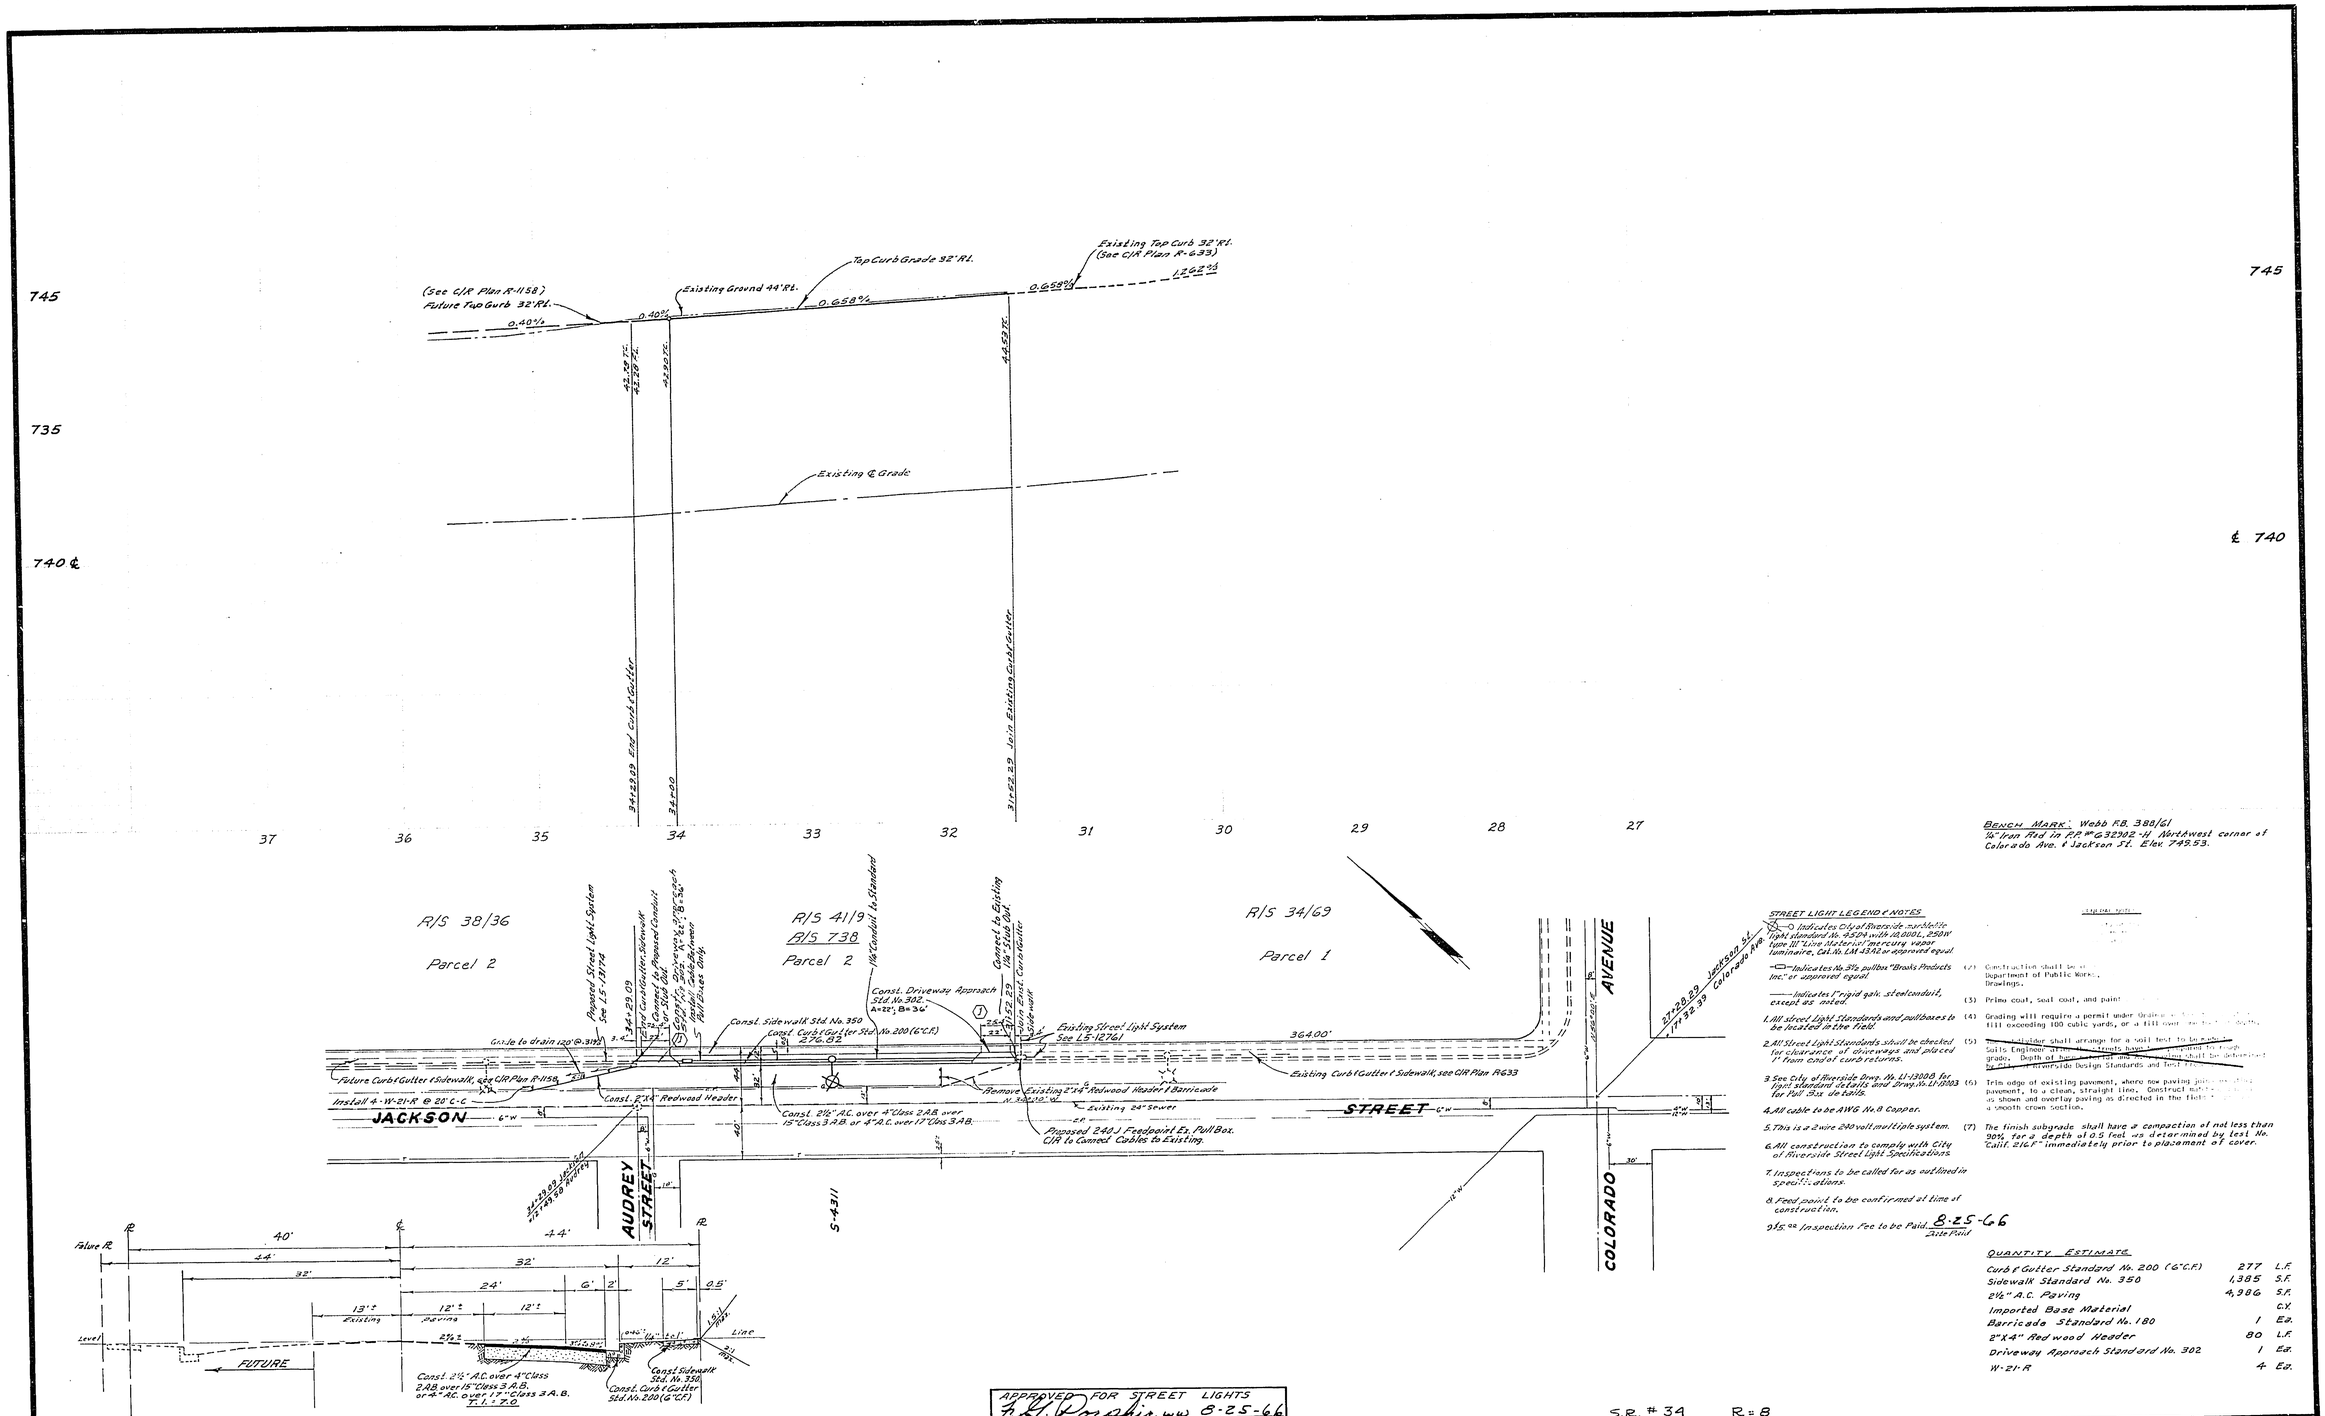

TYPICAL SECTION
JACKSON STREET
NO SCALE

BENCH MARK: Webb F.B. 388/61
¾" Iron Rod in P.P. #G32902-H Northwest corner of Colorado Ave. & Jackson St. Elev. 745.53.

STREET LIGHT LEGEND & NOTES

Indicates City of Riverside curb style light standard No. 4524 with 10,000L, 250W type III "Line Material" mercury vapor luminaire, Cat. No. LM-43-E or approved equal.

Indicates No. 37½ pullbox "Brooks Products Inc." or approved equal.

Indicates 1" rigid galv. steel conduit, except as noted.

1. All street light standards and pullboxes to be located in the field.
2. All street light standards shall be checked for clearance of driveways and placed 1' from end of curb returns.
3. See City of Riverside Dwg. No. LI-13008 for light standard details and Dwg. No. LI-13103 for Pull Box details.
4. All cable to be AWG No. 8 Copper.
5. This is a 2 wire 240 volt multiple system.
6. All construction to comply with City of Riverside Street Light Specifications.
7. Inspections to be called for as outlined in specifications.
8. Feed point to be confirmed at time of construction.

9. $25.00 Inspection Fee to be Paid 8-25-66 Date Paid

GENERAL NOTES

(2) Construction shall be in accordance with the Standard Specifications of the Department of Public Works, City of Riverside, and the Standard Drawings.

(3) Prime coat, seal coat, and paint [illegible]

(4) Grading will require a permit under Grading Ordinance No. [illegible] if exceeding 50 cubic yards, or a fill over [illegible] feet in depth, fill exceeding 100 cubic yards, or a fill over [illegible] feet in depth.

(5) Contractor shall arrange for a soil test to be made by the Soils Engineer after the trench has been excavated to trench grade. Depth of base material and [illegible] shall be determined by the Riverside Design Standards and Test [illegible]

(6) Trim edge of existing pavement, where new paving joins the existing pavement, to a clean, straight line. Construct matching [illegible] as shown and overlay paving as directed in the field to [illegible] a smooth crown section.

(7) The finish subgrade shall have a compaction of not less than 90% for a depth of 0.5 foot as determined by test No. "Calif. 216 F" immediately prior to placement of cover.

QUANTITY ESTIMATE

Curb & Gutter Standard No. 200 (6" C.F.)	277	L.F.
Sidewalk Standard No. 350	1,385	S.F.
2½" A.C. Paving	4,986	S.F.
Imported Base Material		C.Y.
Barricade Standard No. 180	1	Ea.
2"X4" Redwood Header	80	L.F.
Driveway Approach Standard No. 302	1	Ea.
W-21-R	4	Ea.

APPROVED FOR STREET LIGHTS
F. H. Porphirio 8-25-66
GEN. SUPT. & CHIEF ENGINEER — DATE

ALBERT A. WEBB ASSOCIATES
CIVIL ENGINEERS
RIVERSIDE, CALIFORNIA
APPROVED BY R. E. Webb DATE 8/1/66
R.E. No. 9876
W.O. 66-209 FOR: Mervyn G. Plary — F.B. 388

MARK	REVISIONS	APPR.	DATE
1	Size & Location of Driveway, Walk & Curb & Gutter at request of Ave. Walk		12/16/70

DESIGNED BY B.E.L. DRAWN BY B.E.L. CHECKED BY

S.R. # 34 R = 8

CITY OF RIVERSIDE, CALIFORNIA
DEPARTMENT OF PUBLIC WORKS

APPROVED BY	BY	DATE
OFFICE ENGINEER	TEK	8-80
PARK DEPARTMENT		
TRAFFIC DIVISION	JKB	8-25
ASSISTANT CITY ENG.	WD	8-30
	Hart	8-26

APPROVED BY William D. Hardesty
DIRECTOR OF PUBLIC WORKS
DATE 8/30/66

STREET PLAN & PROFILE
JACKSON STREET
364' ± Westerly of Colorado Ave. Northerly side (R/S No. 738)
PARCEL 2, R/S 41/9

HORIZ. SCALE: 1" = 50' VERT. SCALE: 1" = 5'

PROJECT NO. 55 340
R-1158-A
LS-13204
SHEET 1 OF 1
FILE NO. 66-209-A