



318-V

EXHIBIT

318-V

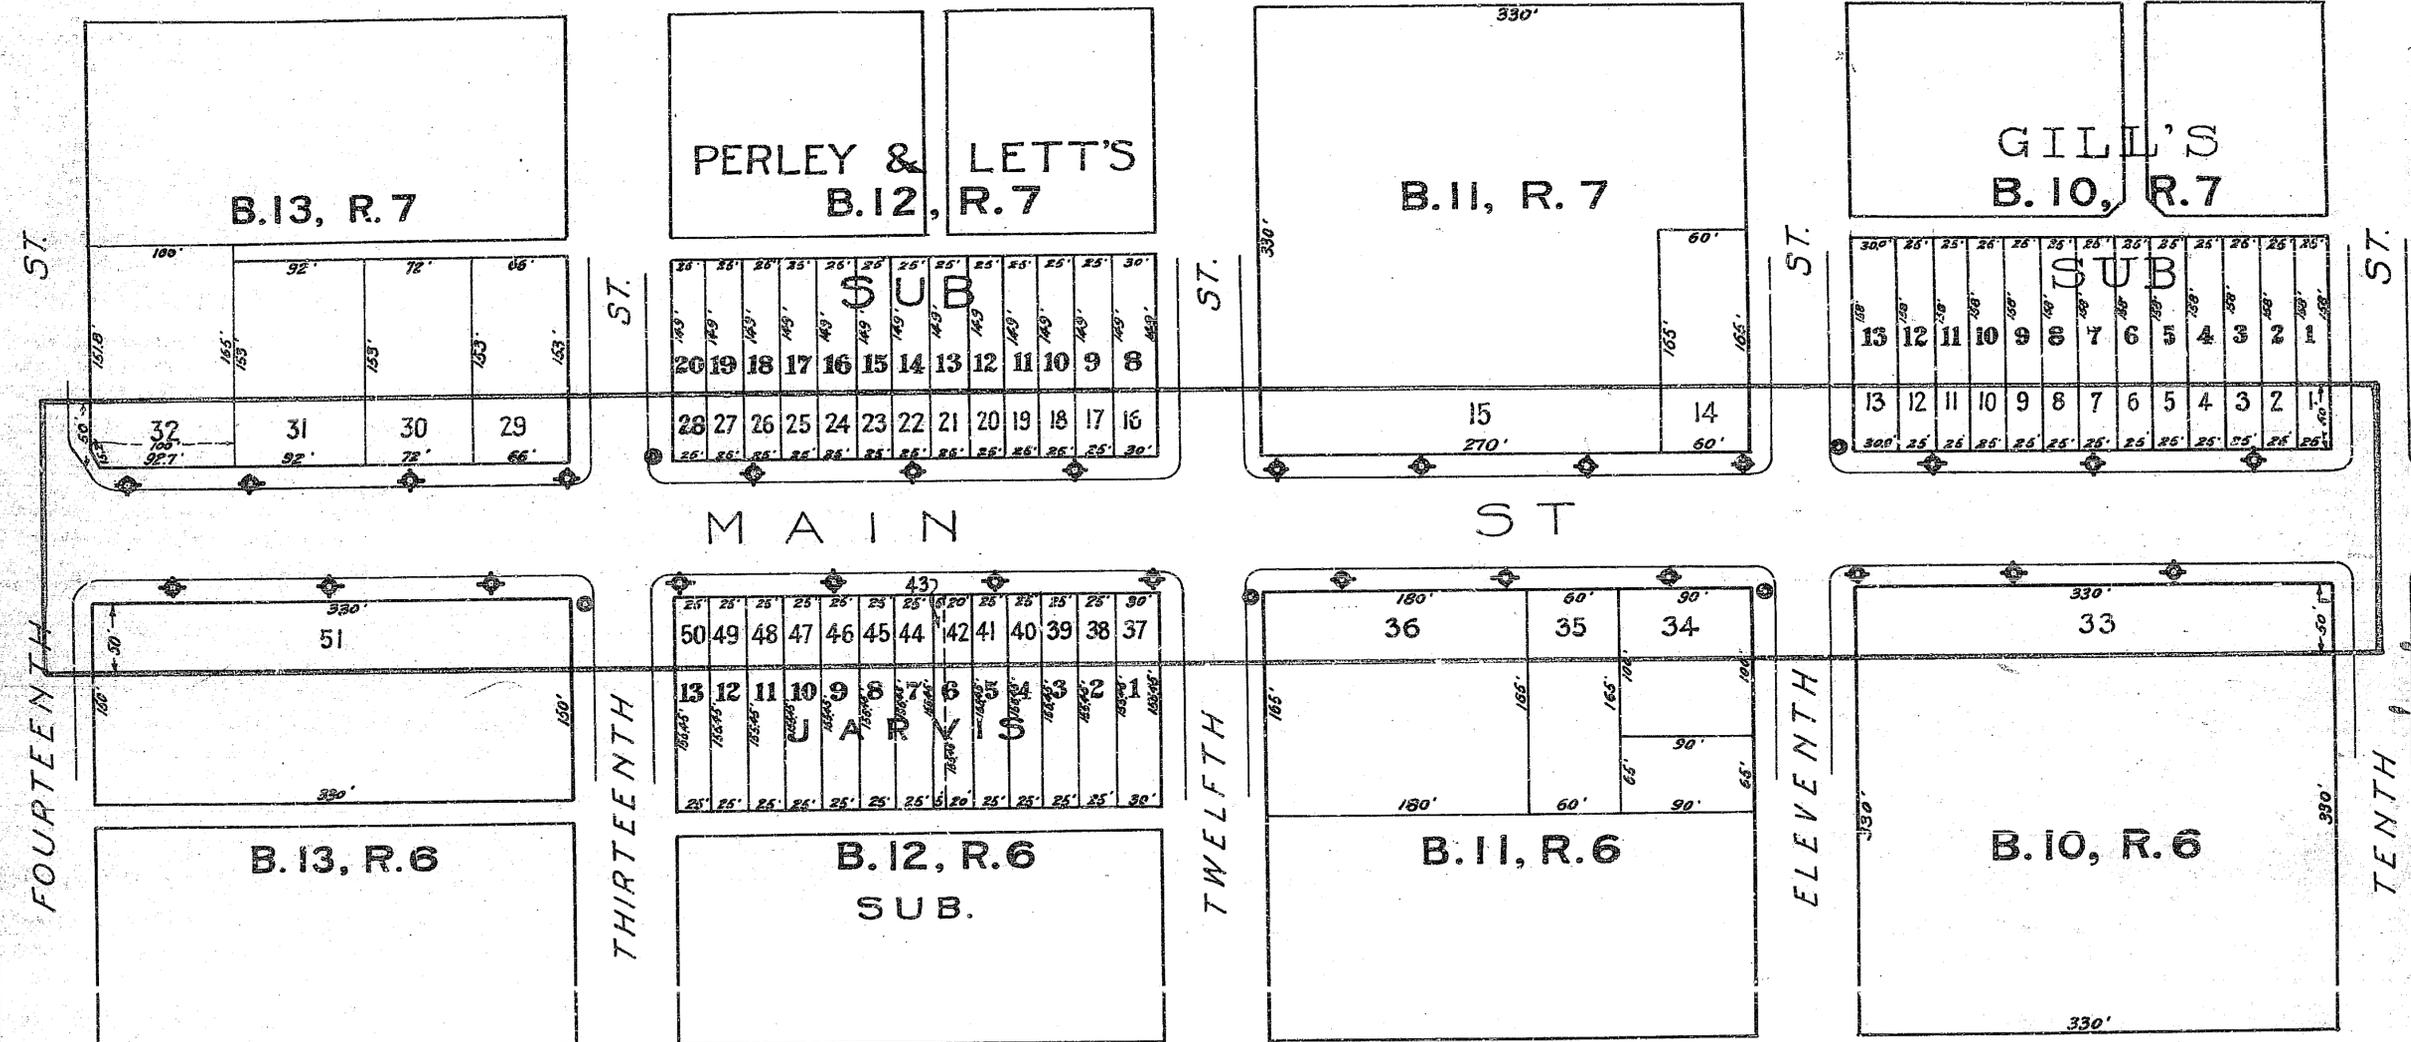

Note  
 Electric light standards, three lamp design, to be installed are shown thus: ◆  
 Electric light standards, one lamp design, to be installed are shown thus: ●  
 District to be assessed is bounded by a green line.  
 Assessment numbers are shown by red figures.

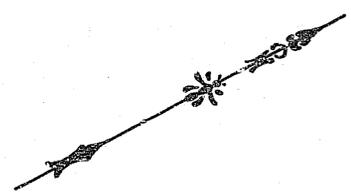

(DIAGRAM)-MAP SHOWING PROPOSED  
 ORNAMENTAL ELECTRIC LIGHTING SYSTEM  
 TO BE INSTALLED ON

**MAIN STREET**

1917  
 A. P. CAMPBELL, CITY ENGINEER.

318 A  
 A-818