


46 STATIC WATER PRESSURE: 105 PSI
 Corner of Alessandro Boulevard
 and Cole Avenue
 Source-W.M.W.D. (780-2450)
 Date: August 1987

* DEVELOPER TO PAY ALL FEES FOR UTILITIES
 & WATER METER HOOK UP.

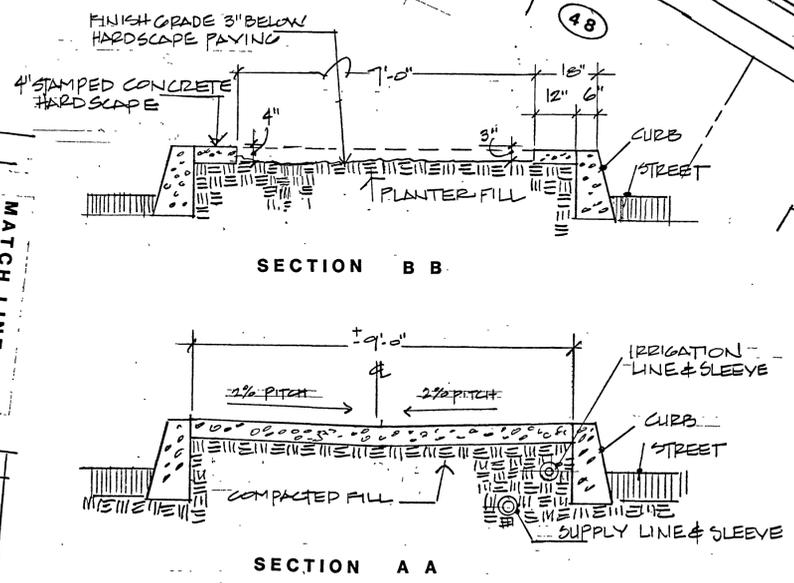

SPRINKLER LEGEND

SYMBOL	PART NO.	MANF'R	DESCRIPTION	PSI	RAD.	GPM
▽	1812 SAM PRS RAINBIRD	QUARTER ARC 12" POP-UP SHRUB SPRAY	30	7'	.65	
▽	1812 SAM PRS RAINBIRD	HALF ARC 12" POP-UP SHRUB SPRAY	30	7'	1.30	

CONTRACTOR NOTE: USE B8Q FLT & B8H FLT-0 TRAJECTORY BRASS NOZZELS WITH 1812 SERIES POP-UP BODY - ADJUST ALL HEADS TO 7 FOOT RADIUS. NO OVERTHROW ONTO HARDSCAPE AREAS WILL BE ALLOWED.

SAM - DENOTES SEAL A MATIC. PRS - DENOTES NEW PRESSURE COMPENSATING SPRINKLER BODY.

- RC-7 150 EFA CP PRS RAIN BD AUTOMATIC SPRINKLER CONTROLLER IN "LE MEUR" ENCLOSURE.
- 33D 3/4" RAINBIRD PRESSURE REGULATING ELECTRIC REMOTE CONTROL VALVE.
- RPA 200 RAINBIRD QUICK COUPLER VALVE W/ VINYLE LOCKING COVER.
- 2001b Class NIBCO 2" REDUCED PRESSURE BACKFLOW PREVENTER WITH GATE VALVES.
- CLASS 200 PVC IRRIGATION LINE BRASS BODY RISING STEM GATE VALVE LINE SIZE IN CONC. VALVE BOX.
- CLASS 315 PVC SUPPLY LINE SLEEVE ALL LINES INSTALLED UNDER CONCRETE.

1 INCH RIGID PLASTIC (OB) CONDUIT W/ 2 #12 CU. THW WIRES PER CITY SPECIFICATIONS
 PULL BOX (10"x17"x12" PER ITEM P-1 OF UGS-800, INSTALL PER UGS-320

GENERAL NOTES FOR PROJECT INSPECTIONS

Contact the Parks Projects Inspector at (714) 782-5223 two working days in advance of the following inspections:

- * Before commencing work.
- * When trenching is complete.
- * For pressure test when main line has been installed - 150 psi for not less than 2 hours.
- * Coverage test.
- * When plant pits are dug - before plants are installed.
- * Final inspection at start of maintenance.
- * Final acceptance after 1 year maintenance.


All irrigation and planting must conform to City of Riverside Standard Park & Recreation Specifications.

NOTE:

IRRIGATION PLAN IS DIAGRAMMATIC DRAWING, WITH SUPPLY LINES SHOWN OVER PAVING. SUPPLY LINES & IRRIGATION LINES SHALL BE INSTALLED PARALLEL AND ADJACENT TO PAVING, WALLS, & CURBS, IN PLANTER AREAS. LINES SHOWN ACROSS PAVING SHALL BE SLEEVED.

COVERAGE TEST: UPON COMPLETION OF THE IRRIGATION SYSTEM INSTALLATION AND PRIOR TO ANY PLANTING THE CONTRACTOR SHALL ADJUST SPRINKLER HEADS TO EVENLY & PROPERLY DISTRIBUTE THE RATE OF PRECIPITATION OF WATER AND SHALL DETERMINE IF COVERAGE OF PLANTING AREAS IS COMPLETE AND ADEQUATE.

THE CONTRACTOR SHALL FURNISH ALL MATERIALS AND PERFORM ALL WORK REQUIRED TO CORRECT ANY INADEQUACIES OF COVERAGE DISCLOSED BY THE COVERAGE TEST. C/RS

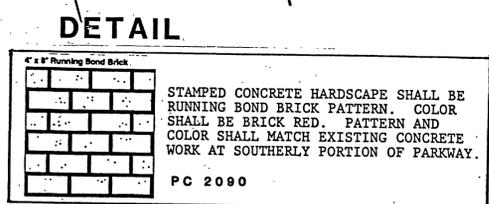

ORTON associates landscape development (714) 985-7000 607 e. seventh st. - upland - ca 91786	CITY OF RIVERSIDE PUBLIC WORKS DEPARTMENT		TRACT 22480 MISSION GROVE PARKWAY DEVELOPMENT PLAN	ACCOUNT NO. R-2930 L SHEET 1 OF 2
	DESIGNED BY: <i>FEO</i> DRAWN BY: <i>FEO</i> CHECKED BY:	APPROVED BY: <i>[Signature]</i> DATE: 3/26/88 PUBLIC WORKS DIRECTOR	DATE: 3/26/88	HORIZ. SCALE: 1" = 20' VERT. SCALE: 1" =

PC 2266

