



PROFILE SCALE
 HORIZ: 1" = 20'
 VERT: 1" = 4'

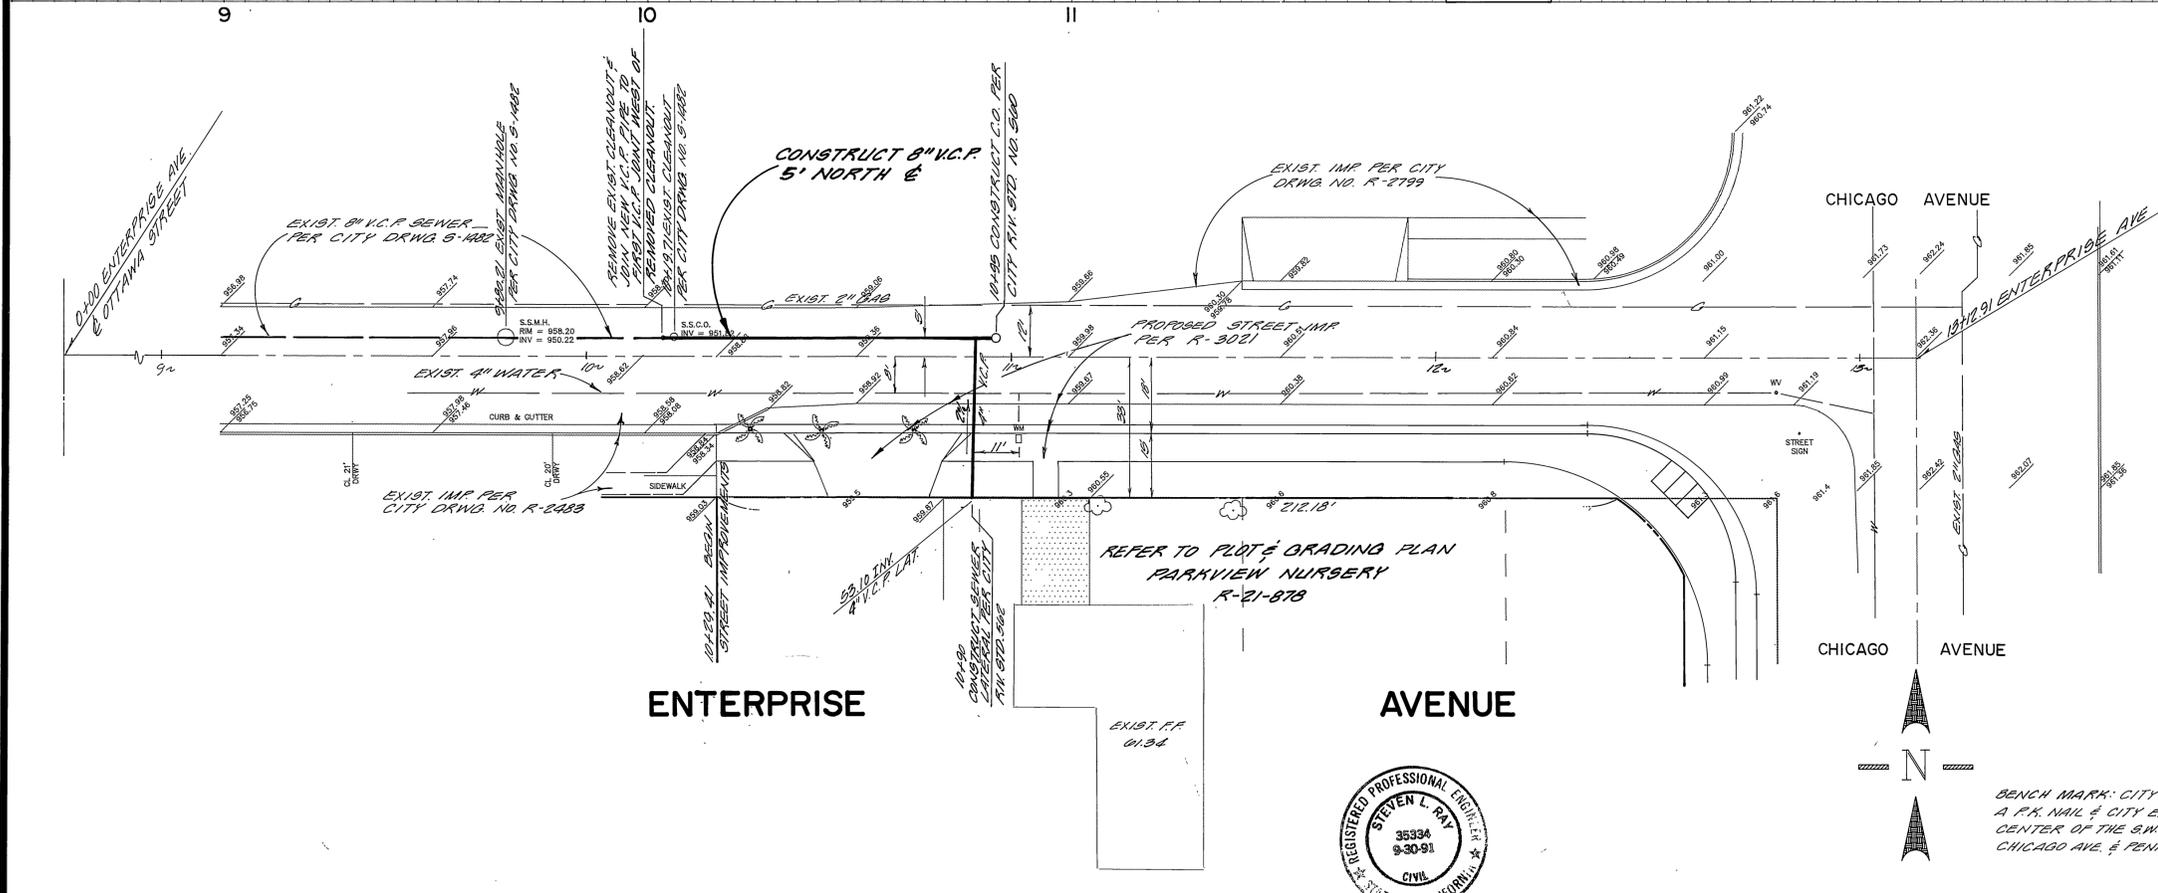

SEWER NOTES

1. It shall be the responsibility of the contractor to clear the right of way in accordance with the provisions of law as it affects each utility including irrigation lines and appurtenances and at not cost to the City.
2. Construction shall be in accordance with the City of Riverside Department of Public Works, Standard Drawings, Standard Drawing No. 10 and the Standard Specifications for Public Works Construction, current edition.
3. The private engineer signing these plans is responsible for assuring the accuracy and acceptability of the work hereon. In the event of discrepancies arising during construction, the private engineer shall be responsible for determining an acceptable solution and revising the plans for approval by the City.
4. The developer shall be responsible for preserving or re-establishing and referencing survey monuments destroyed, disturbed or buried as a result of construction shown hereon.
5. All flagged elevations shall be staked in the field by the private engineer.
6. The contractor shall call in a location request to Underground Service Alert (USA), Phone No. 1-800-422-4133, two working days before digging. No construction permit will be issued by the Public Works Department involving excavation for underground facilities unless the applicant has been provided an inquiry identification number by U.S.A.
7. Location of laterals to be determined in the field at the direction of the owner. Avoid conflict with proposed and/or existing facilities.
8. No finished floor elevation shall be less than 4' above the sewer flow line at point of connection without having a proper backwater valve installed in the lateral.
9. A plug shall be installed and will remain in place where the new sewer connects with the existing sewer until the new sewer is accepted by the City.
10. The sewer contractor shall adjust manholes to final grade after paving is completed.
11. All sewer stubs and laterals are to be constructed in accordance with Std. Drwg. No. 562.
12. Refer to Std. Drwg. 453 for trench backfill and pipe bedding.
13. Sewer laterals are to be 4" V.C.P. extended to property line.
14. Prior to construction of the sewer, the contractor is to expose the existing sewer and contact the engineer for verification of existing location and elevation.

BENCH MARK: CITY OF RIVERSIDE B.M. 47-D,
 A P.N. NAIL & CITY ENGINEER TAG IN THE
 CENTER OF THE S.W. CURB RETURN OF
 CHICAGO AVE. & PENNSYLVANIA AVE.
 ELEV. 971.111



APPROVED BY: DATE: 11-2-88 	APPROVED BY: DATE: 4/4/88 	APPROVED BY: DATE: 9-9-88 	CITY OF RIVERSIDE WATER SYSTEM APPROVED BY: DATE: 11-3-88	GFB & ASSOCIATES, INC. 6809 INDIANA AVENUE SUITE 201 RIVERSIDE, CA. 92506 (714) 781-0811 APPROVED BY: REGISTERED CIVIL ENGINEER NO. 35334 DATE: 9-8-88	CITY OF RIVERSIDE, CALIFORNIA PUBLIC WORKS DEPARTMENT APPROVED BY: DATE: 1/26/89 BY DATE: 1/26/89 TRAFFIC DIVISION CHIEF PUB. WKS. ENGR.	SEWER IMPROVEMENT PLAN ENTERPRISE AVENUE C-46-878 SCALE: HORIZ. 1" = 20' VERT. 1" = 4'	ACCOUNT No. DRAWING NUMBER 5-1529 SHEET 1 OF 1
-----------------------------------	----------------------------------	----------------------------------	--	--	---	--	--