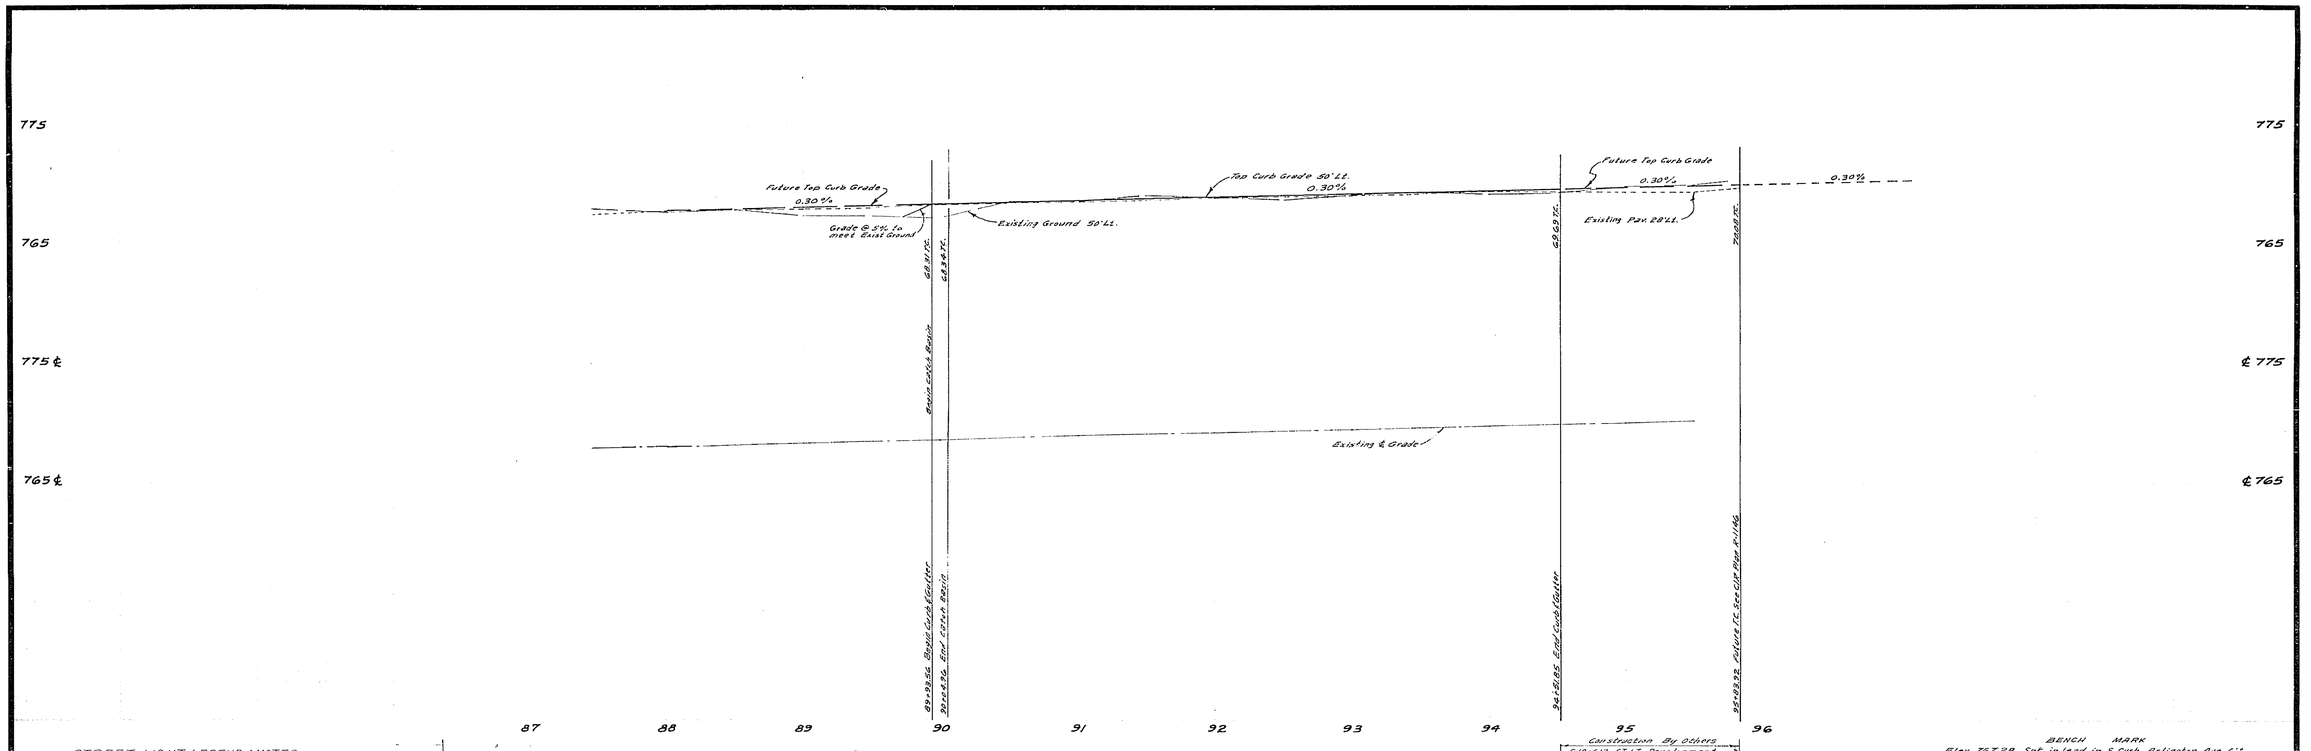

STREET LIGHT LEGEND & NOTES

- Indicates City of Riverside marble lite light standard No. GB-110 with 2@300L, 400W, type III "Line Material" mercury vapor luminaire, Cat. No. LM5342 or approved equal.
- Indicates No. 372 pullbox "Brooks Products Inc." or approved equal.
- Indicates 1" rigid galv. steel conduit, except as noted.

1. All street light standards and pullboxes to be located in the field
2. All street light standards shall be checked for clearance of driveways and placed 1' from end of curb returns.
3. See City of Riverside Dwg. No. LT-13011 for light standard details and Dwg. No. LT-13003 for pullbox details.
4. All cable to be AWG No. 8 copper.
5. This is a 2 wire 240 volt multiple system.
6. All construction to comply with City of Riverside Street Light Specifications.
7. Inspections to be called for as outlined in Specifications.
8. Feed point to be confirmed at time of construction.
9. Feed point to be determined.
10. $75.00 connection fee to be paid for R/S 979 _____ (Date Paid)
11. $ 0.00 inspection fee to be paid for R/S 979 _____ (Date Paid)
12. The City of Riverside Traffic Engineering Division will pay $ 225.00 toward the cost of this project to the Developer upon completion of the work and receipt of a statement from the Developer. (a) $150.00 toward R/S 979, (b) $75.00 toward C-18-612.
13. Excavation for street light standard bases, pullboxes and conduits must be done after installation of curb and gutters, but before installation of sidewalks.
14. Backfill to be of type and compacted as specified by City of Riverside Public Works Department.
15. $5.00 inspection fee to be paid for C18-612 _____ (Date Paid)

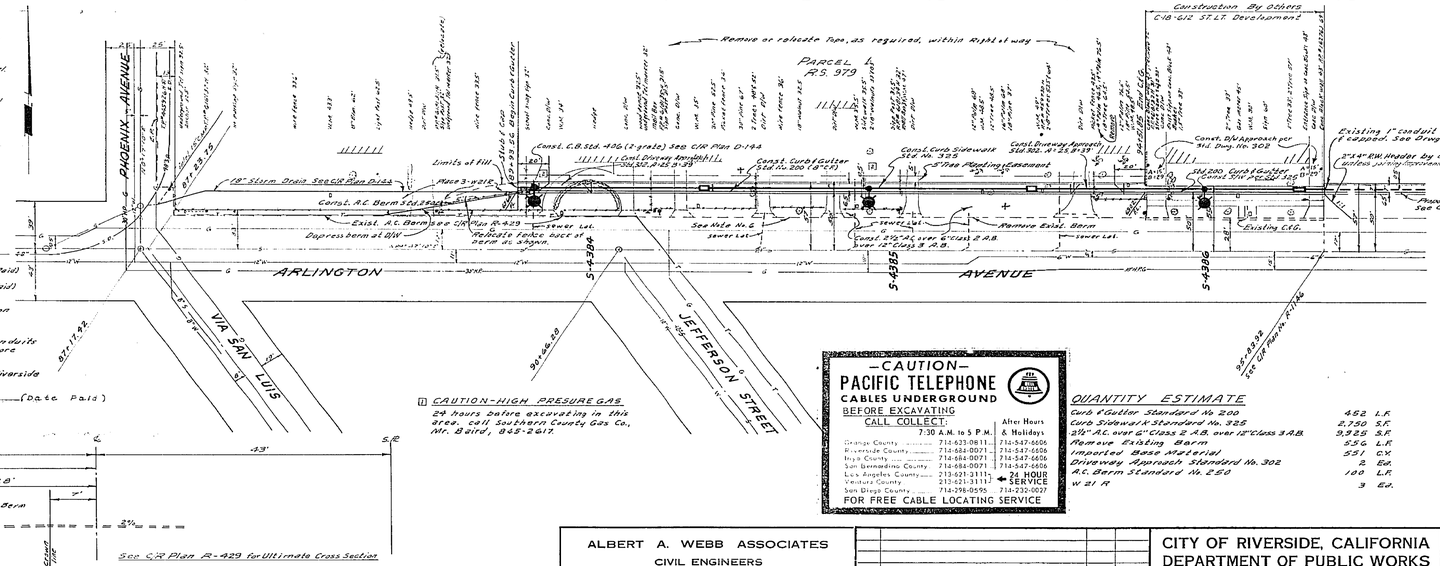

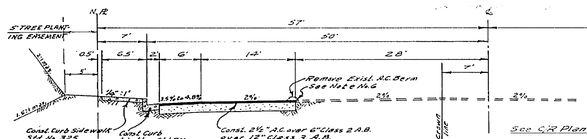

ARLINGTON AVENUE TYPICAL SECTION

89+93.56 to 94+51.85

NO SCALE

Approved for Street Lights
Gail Sapp, Chief Engineer
Date: 12-14-66

CAUTION-HIGH PRESURE GAS

24 hours before excavating in this area, call Southern County Gas Co., Mr. Baird, 855-2617.

-CAUTION-

PACIFIC TELEPHONE

CABLES UNDERGROUND

BEFORE EXCAVATING CALL COLLECT:

	7:30 A.M. to 5 P.M.	After Hours & Holidays
Orange County	714-623-0811	714-547-6606
Riverside County	714-684-0071	714-547-6606
Inyo County	714-684-0071	714-547-6606
San Bernardino County	714-684-0071	714-547-6606
Los Angeles County	213-621-3111	24 HOUR SERVICE
Ventura County	213-621-3111	
San Diego County	714-298-0595	714-232-0027

FOR FREE CABLE LOCATING SERVICE

QUANTITY ESTIMATE

Curb & Gutter Standard No. 200	452	L.F.
Curb Sidewalk Standard No. 325	2,750	S.F.
2½" A.C. over 6" Class 2 A.B. over 12" Class 3 A.B.	3,325	S.F.
Remove Existing Berm	256	L.F.
Imported Base Material	551	C.Y.
Driveway Approach Standard No. 302	2	Ea.
A.C. Berm Standard No. 250	100	L.F.
W 21 R	3	Ea.

BENCH MARK

Elev. 767.28, Spk in lead in S. Curb Arlington Ave. 6'± W'ly of Phoenix Ave. Webb F.B. 67-121

GENERAL NOTES

(1) It shall be the responsibility of the contractor to clear the [illegible] in accordance with the provisions of law as it affects [illegible], irrigation lines and appurtenances, and [illegible] facility.

(2) [illegible] shall be in accordance with the City of Riverside, [illegible] of Public Works, Specifications No. 461 and Standard [illegible]

(3) [illegible] coat, seal coat, and paint binder are required.

(4) Grading will require a permit under Ordinance 3095 for a cut or fill exceeding 100 cubic yards, or a fill over one foot in depth.

(5) The subdivider shall arrange for a soil test to be made by Soils Engineer after the streets have been graded to rough grade. Depth of base material and AC paving shall be determined by City of Riverside Design Standards and Test Procedures.

(6) Trim edge of existing pavement, where new paving joins existing pavement, to a clean, straight line. Construct match-up paving as shown and overlay paving as directed in the field to produce a smooth crown section.

(7) The finished sub-grade shall have a compaction of not less than 90% for a depth of 0.5 feet as determined by test method No. "Calif. 216" "Compaction of Soil and Base Materials".

(8) Contact Public Utilities Engineering for Street Light Requirements prior to sidewalk construction.

(9) For relocation of any city domestic or irrigation water facility, or Electric Power Utility facility to be done by city forces contact G. Hoare, Water Commercial Engineer at 787-7481. Schedule about 2 weeks to process a work order before relocation work begins.

TO CONTRACTOR

The existence and location of any underground utility pipe structures shown on these plans are obtained by [illegible] available records. To the best of our knowledge, [illegible] existing utilities except as shown on these plans.

The contractor is required to [illegible] protect the utility [illegible] not shown on the [illegible]

ALBERT A. WEBB ASSOCIATES
CIVIL ENGINEERS
RIVERSIDE, CALIFORNIA

APPROVED BY Albert A. Webb DATE 12/1/66

R.E. No. 9872

W.O. 66-96 FOR: FRANK MILLER F.B. 624

MARK	REVISIONS	APPR.	DATE
2	Revised location of two light standards	DC	3-17-67
1	Added CAUTION NOTE CIVIL	[illegible]	12-14-66

DESIGNED BY BFL DRAWN BY BFL CHECKED BY REC

CITY OF RIVERSIDE, CALIFORNIA
DEPARTMENT OF PUBLIC WORKS

APPROVED BY	BY	DATE
OFFICE ENGINEER	[illegible]	12-19
PARK DEPARTMENT	[illegible]	12-16
TRAFFIC DIVISION	[illegible]	12-20
ASSISTANT CITY ENG.	[illegible]	12-20

APPROVED BY [illegible]
DIRECTOR OF PUBLIC WORKS
DATE 12-20-66

STREET PLAN & PROFILE

ARLINGTON AVENUE

NORTH SIDE

1,257'-1,715' WLY OF STREETER AVE.

R.S. 979 & C18-612 ST.LT.

HORIZ. SCALE: 1" = 50' VERT. SCALE: 1" = 5'

PROJECT NO. R-1203

L5-13228

SHEET 1 OF 1

FILE NO. 66-96-A