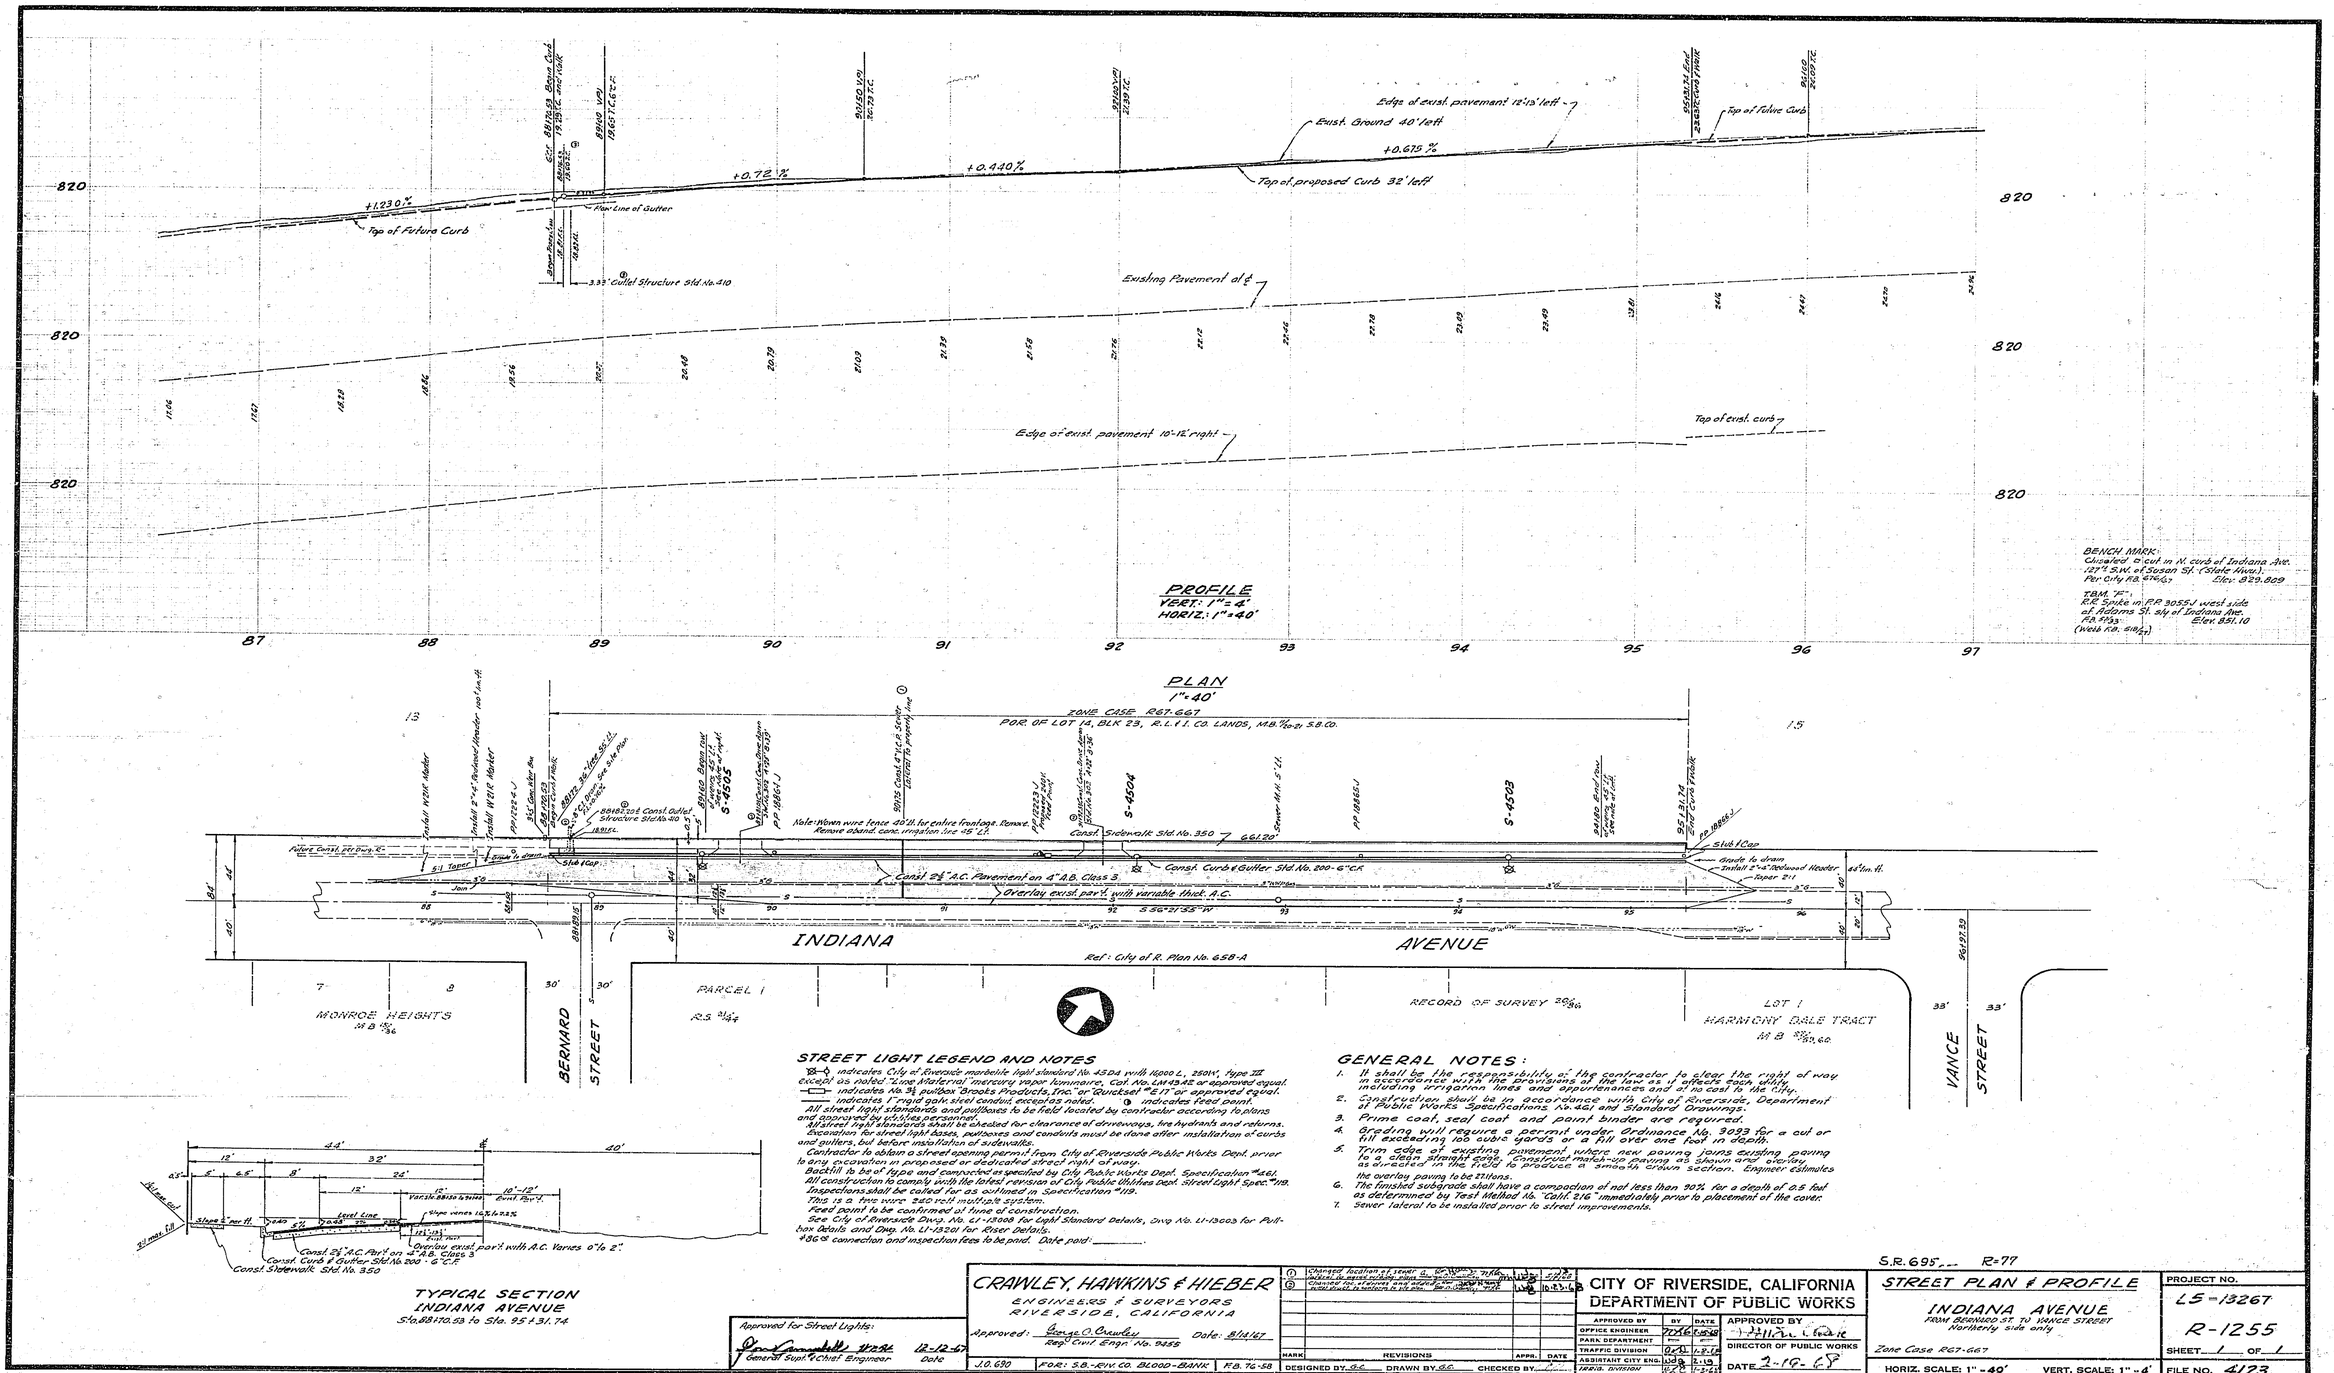

TYPICAL SECTION
INDIANA AVENUE
Sta. 88+70.58 to Sta. 95+31.74

STREET LIGHT LEGEND AND NOTES

indicates City of Riverside marbelite light standard No. 4SD4 with 16000 L, 250W, Type III except as noted "Line Material" mercury vapor luminaire, Cat. No. LM 4SA5 or approved equal.

indicates No. 3½ pullbox "Brooks Products, Inc." or "Rockset" "E17" or approved equal.

indicates 1" rigid galv. steel conduit, excepts noted.

indicates feed point.

All street light standards and pullboxes to be field located by contractor according to plans and approved by City's representative.

All street light standards shall be checked for clearance of driveways, fire hydrants and returns.

Excavation for street light bases, pullboxes and conduits must be done after installation of curbs and gutters, but before installation of sidewalks.

Contractor to obtain a street opening permit from City of Riverside Public Works Dept. prior to any excavation in proposed or dedicated street right of way.

Backfill to be of type and compacted as specified by City Public Works Dept. Specification #561.

All construction to comply with the latest revision of City Public Utilities Dept. Street Light Spec. #119.

Inspections shall be called for as outlined in Specification #119.

This is a two wire 240 volt multiple system.

Feed point to be confirmed at time of construction.

See City of Riverside Dwg. No. LI-13008 for Light Standard Details, Dwg. No. LI-13003 for Pullbox Details and Dwg. No. LI-13201 for Riser Details.

$36.00 connection and inspection fees to be paid. Date paid: _____

GENERAL NOTES:

1. It shall be the responsibility of the contractor to clear the right of way in accordance with the provisions of the law as it affects each utility, including irrigation lines and appurtenances and at no cost to the city.
2. Construction shall be in accordance with City of Riverside, Department of Public Works Specifications No. 441 and Standard Drawings.
3. Prime coat, seal coat and paint binder are required.
4. Grading will require a permit under Ordinance No. 3093 for a cut or fill exceeding 100 cubic yards or a fill over one foot in depth.
5. Trim edge of existing pavement where new paving joins existing paving to a depth sufficient enough to produce a smooth grade after overlay as directed in the field to produce a smooth crown section. Engineer estimates the overlay paving to be 2½ tons.
6. The finished subgrade shall have a compaction of not less than 90% for a depth of 0.5 feet as determined by Test Method No. "Calif. 216" immediately prior to placement of the cover.
7. Sewer lateral to be installed prior to street improvements.

Approved for Street Lights:
General Supt. & Chief Engineer — Date 12-12-67

CRAWLEY, HAWKINS & HIEBER
ENGINEERS & SURVEYORS
RIVERSIDE, CALIFORNIA
Approved: George O. Crawley, Regd. Civil Engr. No. 9355 — Date: 8/14/67

MARK	REVISIONS	APPR.	DATE
1	Changed location of ℄ street & deleted 16 meter street lights		7-15-68
2	Revised to show 2 meters & 2 pullboxes		10-23-68

J.O. 690 | FOR: S.B. RIV. CO. BLOOD-BANK | F.B. 76-58 | DESIGNED BY G.C. | DRAWN BY G.C. | CHECKED BY

CITY OF RIVERSIDE, CALIFORNIA
DEPARTMENT OF PUBLIC WORKS

	BY	DATE	APPROVED BY
OFFICE ENGINEER		7-17-68	
PARK DEPARTMENT		—	DIRECTOR OF PUBLIC WORKS
TRAFFIC DIVISION		7-23-68	
ASSISTANT CITY ENG.		7-23-68	DATE 2-19-68
PUBLIC WORKS DIR.		7-23-68	

S.R. 695 R-77

STREET PLAN & PROFILE
INDIANA AVENUE
FROM BERNARD ST. TO VANCE STREET
Northerly side only
Zone Case R67-667
HORIZ. SCALE: 1" = 40' VERT. SCALE: 1" = 4'

PROJECT NO. LS-1326T
R-1255
SHEET 1 OF 1
FILE NO. 4123