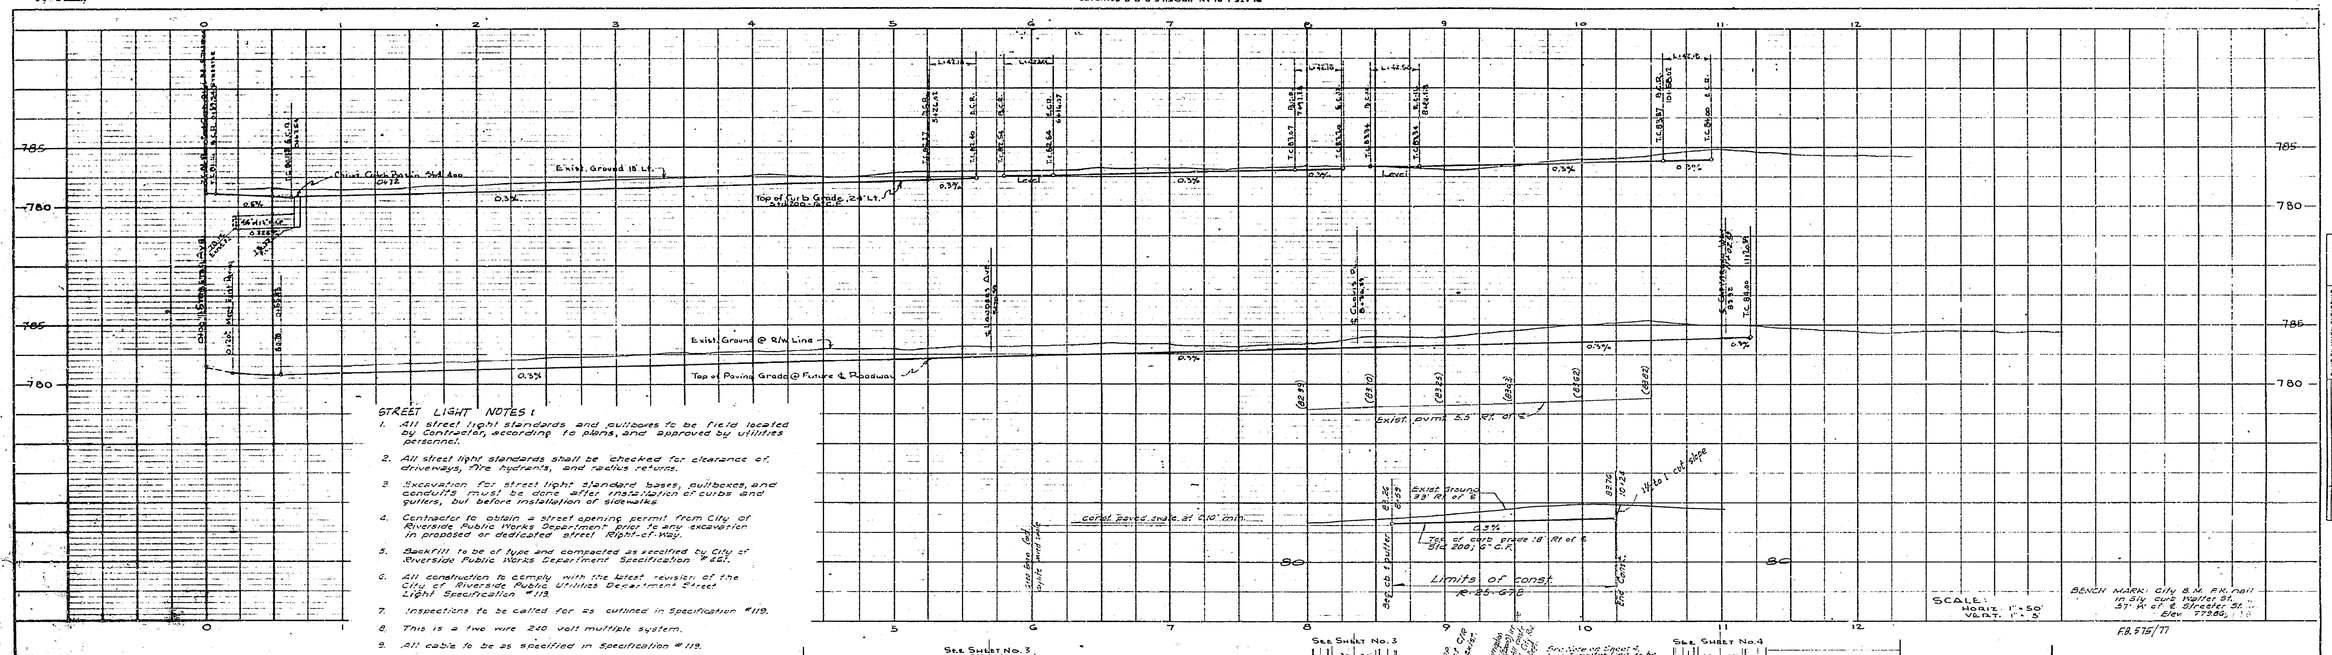

STREET LIGHT NOTES:

1. All street light standards and pullboxes to be field located by Contractor, according to plans, and approved by utilities personnel.
2. All street light standards shall be checked for clearance of driveways, fire hydrants, and radius returns.
3. Excavation for street light standard bases, pullboxes, and conduits must be done after installation of curbs and gutters, but before installation of sidewalks.
4. Contractor to obtain a street opening permit from City of Riverside Public Works Department prior to any excavation in proposed or dedicated street Right-of-Way.
5. Backfill to be of type and compacted as specified by City of Riverside Public Works Department Specification #461.
6. All construction to comply with the latest revision of the City of Riverside Public Utilities Department Street Light Specification #119.
7. Inspections to be called for as outlined in Specification #119.
8. This is a two wire 240 volt multiple system.
9. All cable to be as specified in Specification #119.
10. Feed point to be confirmed at time of construction.
11. See City of Riverside Dwg. No 41-13008 for Light Standard Details.
12. $5.00 connection and Inspection Fee to be paid.

Indicates City of Riverside marbleite light standard No 4504 with 7000L, 175W, type II except as noted "Line Material" mercury vapor luminaire Cat. No LM4421 or approved equal.

Indicates 1" rigid galv. steel conduit except as noted.

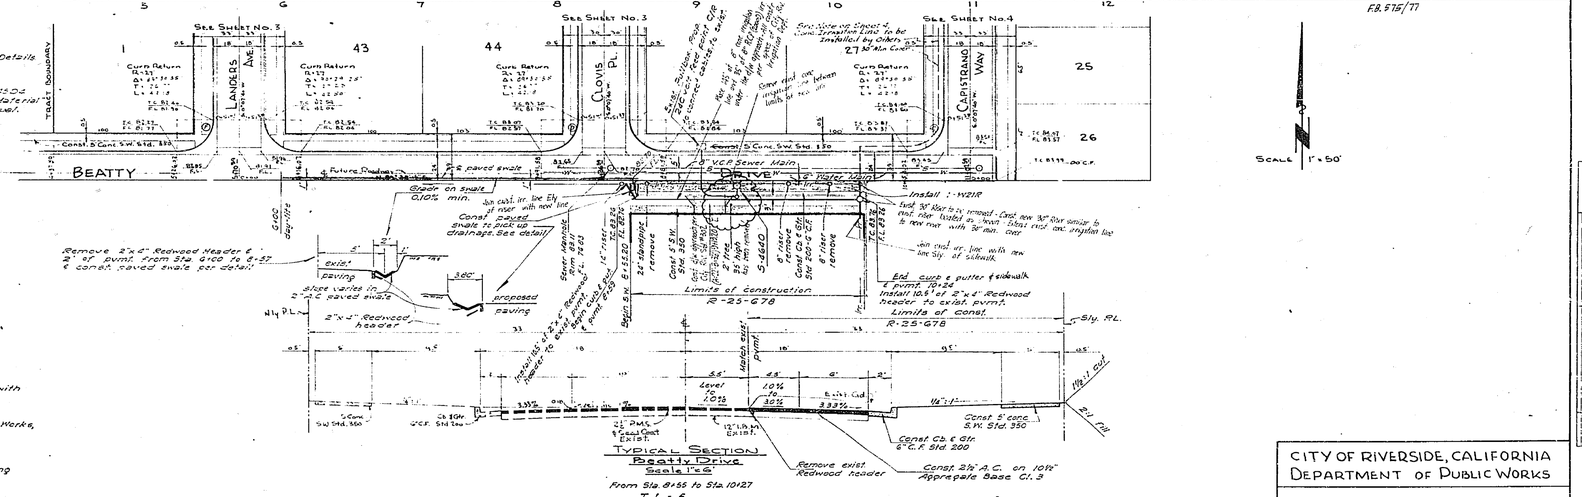

GENERAL NOTES:

1. It shall be the responsibility of the Contractor to clear the right of way in accordance with the provisions of law as it affects each utility including irrigation lines and appurtenances at no cost to the City.
2. Construction shall be in accordance with the City of Riverside, Dept. of Public Works, Specifications No 461 and Standard Drawings.
3. Prime Coat, Seal Coat and Paint Binder are required.
4. Grading will require a permit under ordinance 3093 for a cut or fill exceeding 100 cu yds. or a fill over one foot in depth.
5. Trim edge of existing paving where new paving joins existing paving to a clean straight line. Construct match-up paving as shown and overlay paving as directed in the field to produce a smooth crown section. Engineer estimates the amount of overlay to be 1 tons.
6. For relocation of any City, Domestic or Irrigation Water Facility, or Electric, Power Utility facility to be done by City forces, contact Charles Hare Water Commercial Engr. at 787-7442. Schedule about 2 weeks to process a work order, before relocation work begins.

PROFILE		
SURVEYED		
PLOTTED		
GRADES CHECKED		
B.M.'s NOTED		
STRUCTURE NOTES AS LAYED		
NO.	BY	DATE

PLAN		
SURVEYED		
PLOTTED		
ALIGNMENT CHECKED		
RT OF WAY CHECKED		
NO.	BY	DATE

S.D. #8 D=18

Approved for Street Lights
Gen. Supt. & Chief Engineer
Date: 5-20-68

Approved by:
Irrigation Dept. 5-28-68 Date

J. F. DAVIDSON ASSOCIATES
Civil Engineers · Surveyors · Planners
Riverside, California.
Approved by George E. McCarty Date: 3-20-68
R.C.E. No 10688
W.O. 1812 For: William Austin Co. F.B. 994/3-8

CITY OF RIVERSIDE, CALIFORNIA
DEPARTMENT OF PUBLIC WORKS

R-25-678
STREET PLANS AND PROFILES
BEATTY DRIVE
So. Side bet. Clovis Pl. & Capistrano Way
Sta. 8+55 to 10+27

Approved by: Director of Public Works
Date 6-26-68

Plan No. LS-13314
R-1292
Sheet 1 of 1

This plan adapted from City of Riv. Plan R-298

FILE No 3352